





DIMENSIONS AND SPECS. ON 450 GAL. SEPTIC TANKS

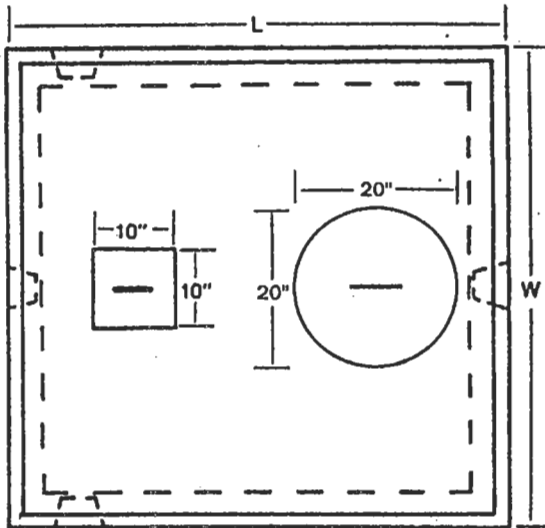

TOP VIEW

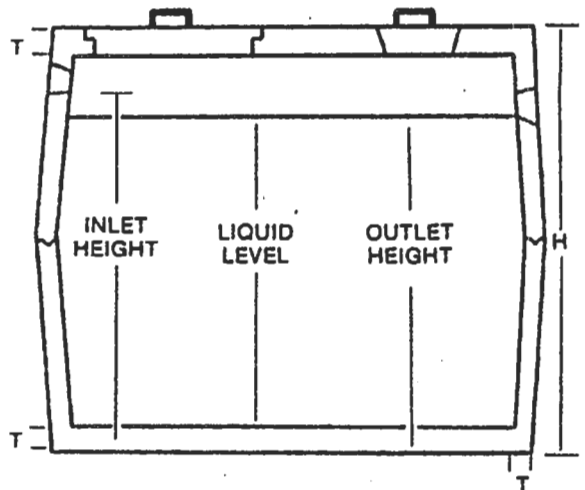

CROSS SECTION

ITEM # W1•101 DESCRIPTION	H	W	L	THICKNESS			I.H.	O.H.	HOLE SIZE			LIQUID LEVEL	WEIGHT (LB.)
				WALL T	FLOOR T	TOP T			W	L	*D		
450 GAL. SEPTIC TANK	4'-6½"	5'-4"	5'-4"	2½"	3"	3½"	3'-8"	3'-6"	6'-6"	6'-6"	3'-8"	3'-3"	4400

- SPECIFICATIONS:**
- Approved by the PEI Dept. of Community & Cultural Affairs
 - 5000 PSI at 28 days
 - Air entraining: 5-7%
 - 10 mm Reinforcing as shown on previous page
 - See detail # W8•001 for Polylok seal detail (page W8•0)
 - See detail # W8•002 for joint detail (page W8•0)

* Depth from bottom of inlet