



1000 IGAL SEPTIC TANK

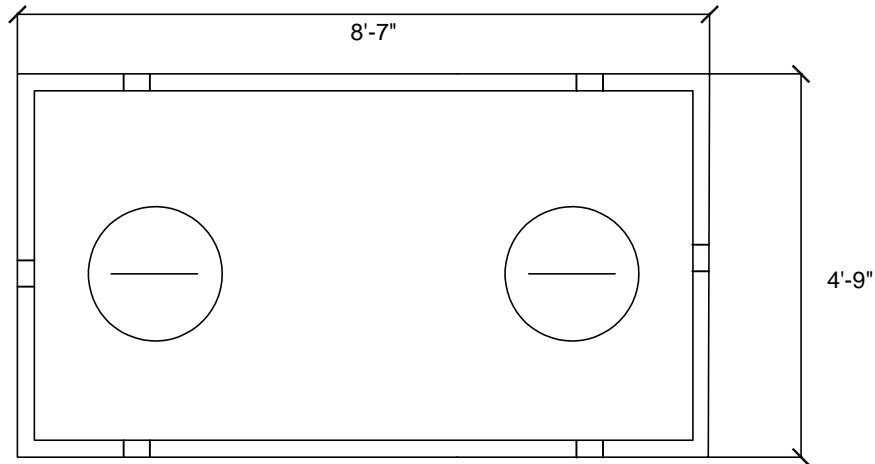

TOP VIEW

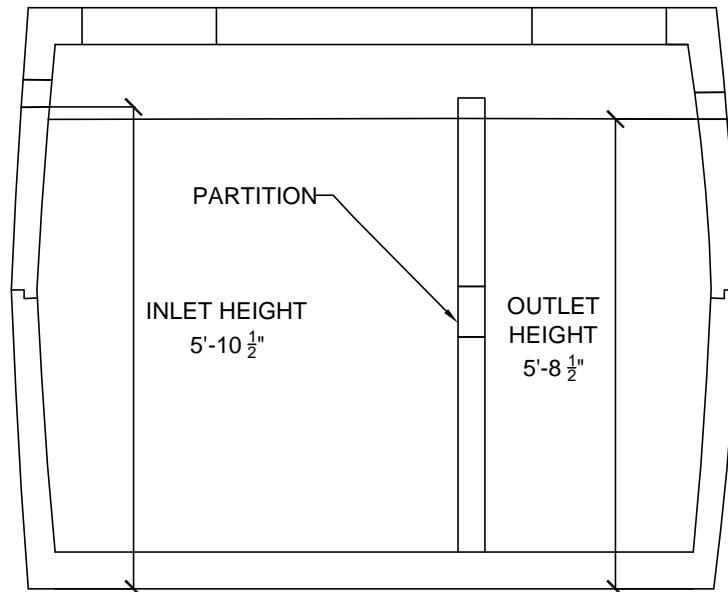

CROSS SECTION

SPECIFICATIONS:
 APPROVED BY PEI DEPT OF ENVIRONMENT
 5000 psi AT 28 DAYS
 AIR ENTRAINING 5-7%
 10mm REBAR REINFORCING
 FIBRE MESH REINFORCING

NOTES: - PARTITION WALL CONTAINS AN 8" X 8" OPENING CENTERED ON LIQUID LEVEL
 - PARTITION EXTENDS 1 1/2" ABOVE LIQUID LEVEL

DESCRIPTION	ITEM#	OUTSIDE DIMENSIONS			THICKNESS			INLET	OUTLET	WEIGHT
		W	L	H	WALL	FLOOR	TOP			
1000 GAL SEPTIC TANK	W2.201	4'-9"	8'-7"	6'-9"	2 1/2"	3 1/2"	3 1/2"	5'-10 1/2"	5'-8 1/2"	8350